
FIREWORK STORAGE SUITABILITY FLOWCHART

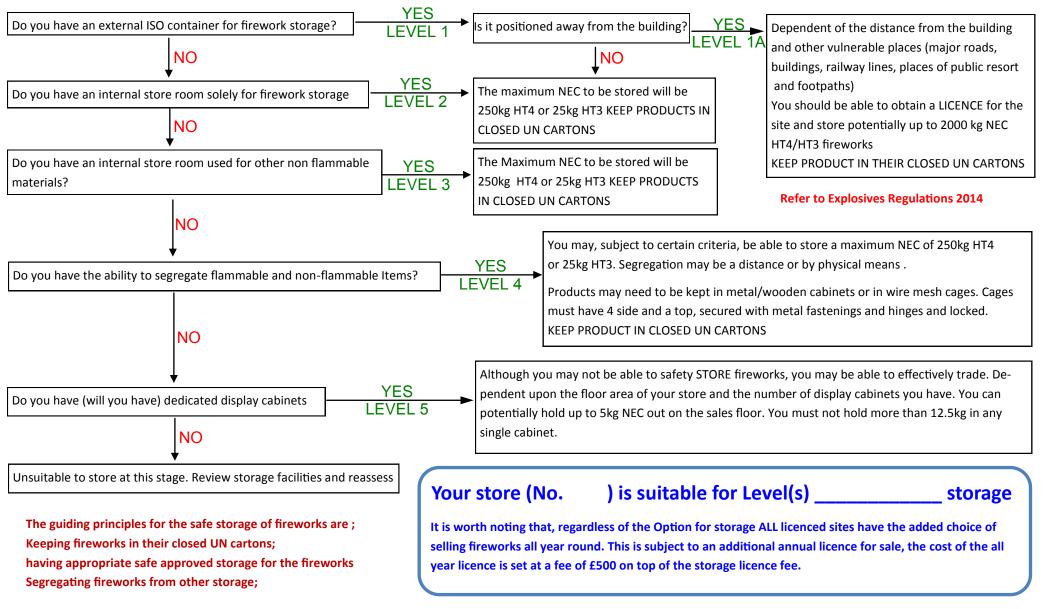

Segregating the fireworks from other storage, especially highly flammable liquids and oxidising agents. In deciding on the degree of segregation necessary, the quantity and hazard type of the fireworks involved and the nature quantity and hazard of other goods must be assessed. Segregation can be achieved by distance/spacing, wire mesh cages cupboards and cabinets.

Enclosing the fireworks in a fire-resisting structure is always advisable where possible, ideally on the ground floor never in a basement or cellar (risk to fire-fighters).

 $Providing\ lightening\ protection\ for\ permanent\ ISO\ storage\ ,\ seasonal\ storage\ HT4\ or\ where\ less\ than\ 75kg\ NEC\ do\ not\ require\ lightening\ protection.$

Prohibiting smoking and taking all other general fire precautions necessary in and around the firework store, and to have a suitable and sufficient DSEAR risk assessment in place